



\\woodwardclark.com\neta\shared\Projects\RM\CSF\002-SFPUC\002-007-SFPUC-WW-CS-955BIB-Task Order\TO 10 - Sewer Laterals Program Phase 1B- Project Work\Task- Revised Standards and Details Completion\Final Submittal\CAD\RevisedSewer Config Figures.dwg

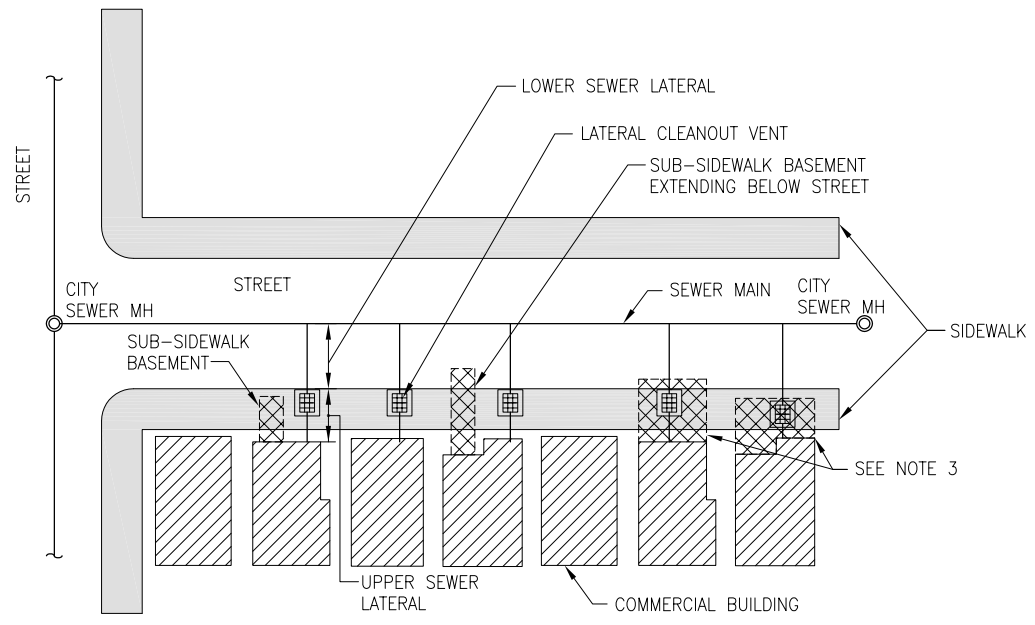

- NOTES:**
1. SEE DETAIL 1 OF DRAWING NO. 4 FOR ALLOWABLE DEVIATION FROM PERPENDICULAR.
 2. SEWER LATERAL CLEANOUT MUST BE LOCATED OUTSIDE OF THE SUB-SIDEWALK BASEMENT AND MUST BE PERPENDICULAR TO CURB WHENEVER POSSIBLE.
 3. IN SITUATIONS WHERE THE CLEANOUT CAN'T BE LOCATED OUTSIDE THE SUB-SIDEWALK BASEMENT, THE ENTIRE SEWER LATERAL FROM THE SEWER MAIN TO THE BUILDING WILL BE THE PROPERTY OWNER'S RESPONSIBILITY.

SPECIAL SEWER LATERAL CONFIGURATION – COMMERCIAL BUILDINGS WITH SUB-SIDEWALK BASEMENTS IN STANDARD CITY STREET 1
 NOT TO SCALE

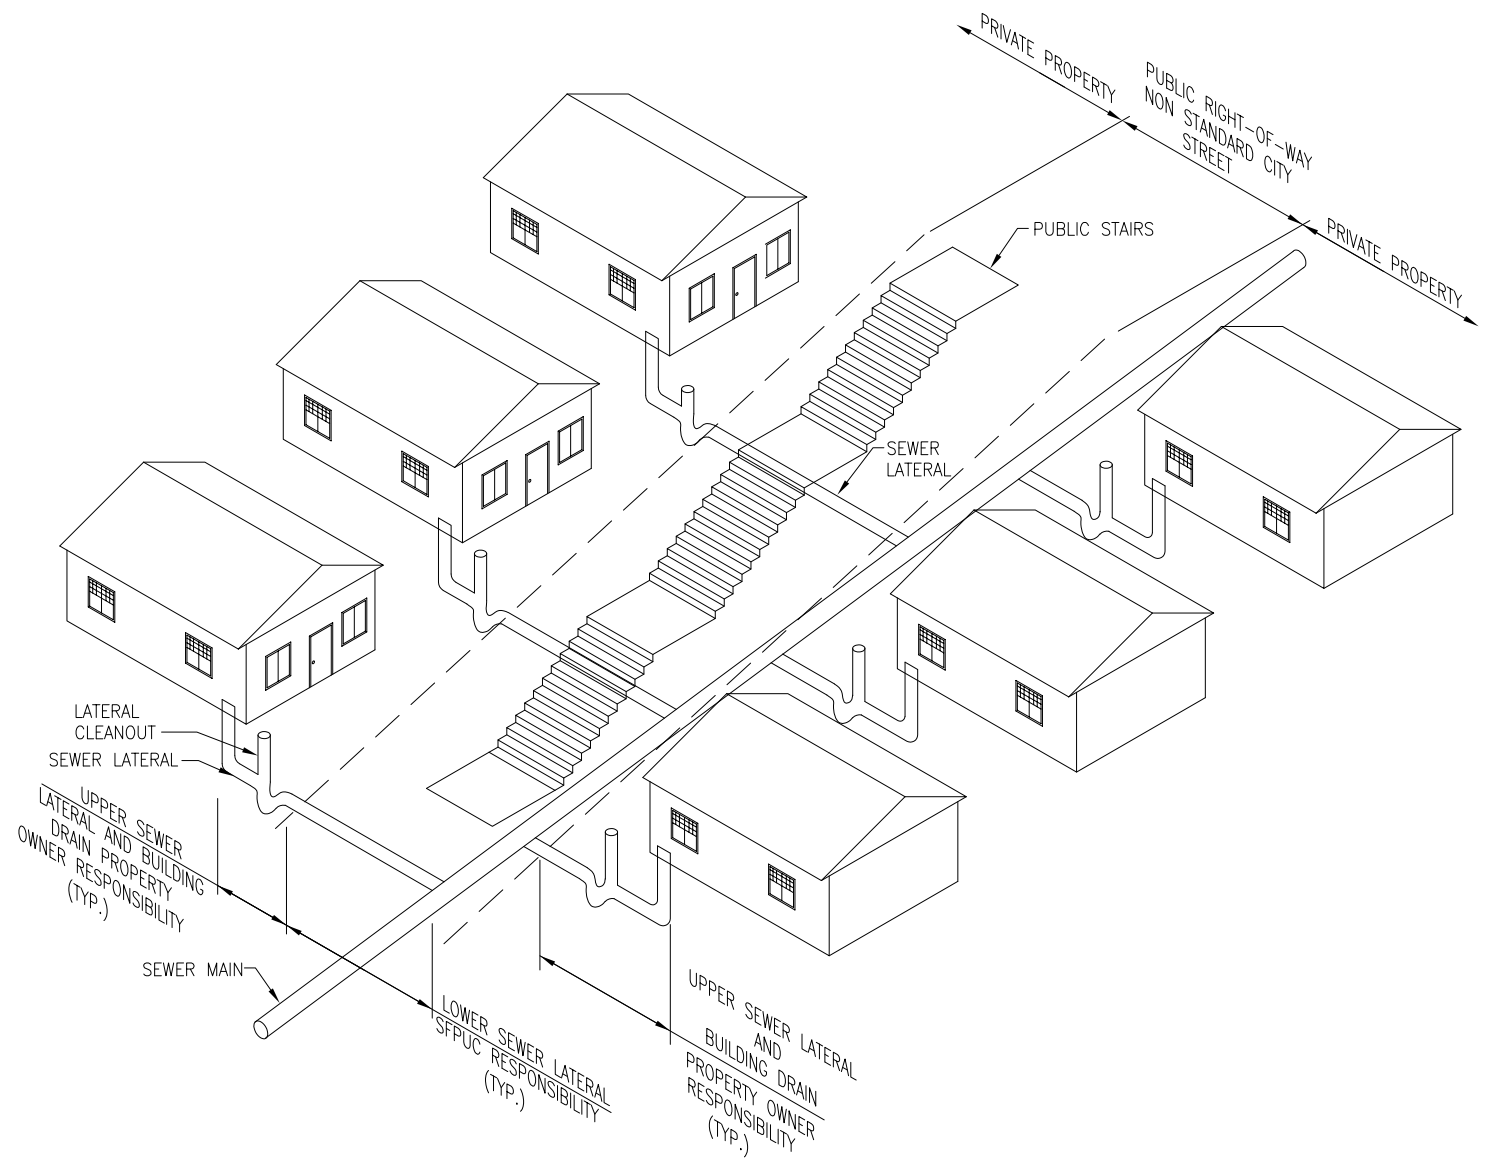

SPECIAL SEWER LATERAL CONFIGURATION IN PUBLIC STAIRS (I.E. NON-STANDARD CITY STREET) 2
 NOT TO SCALE

APPLICABLE TO BOTH COMBINED AND SANITARY SEWER SYSTEMS



SEWER LATERAL STANDARD DETAILS
 SAN FRANCISCO PUBLIC UTILITIES COMMISSION

DATE MAY 2017	REVISION 1.0	REVISED
------------------	-----------------	---------

SPECIAL SEWER LATERAL CONFIGURATIONS